



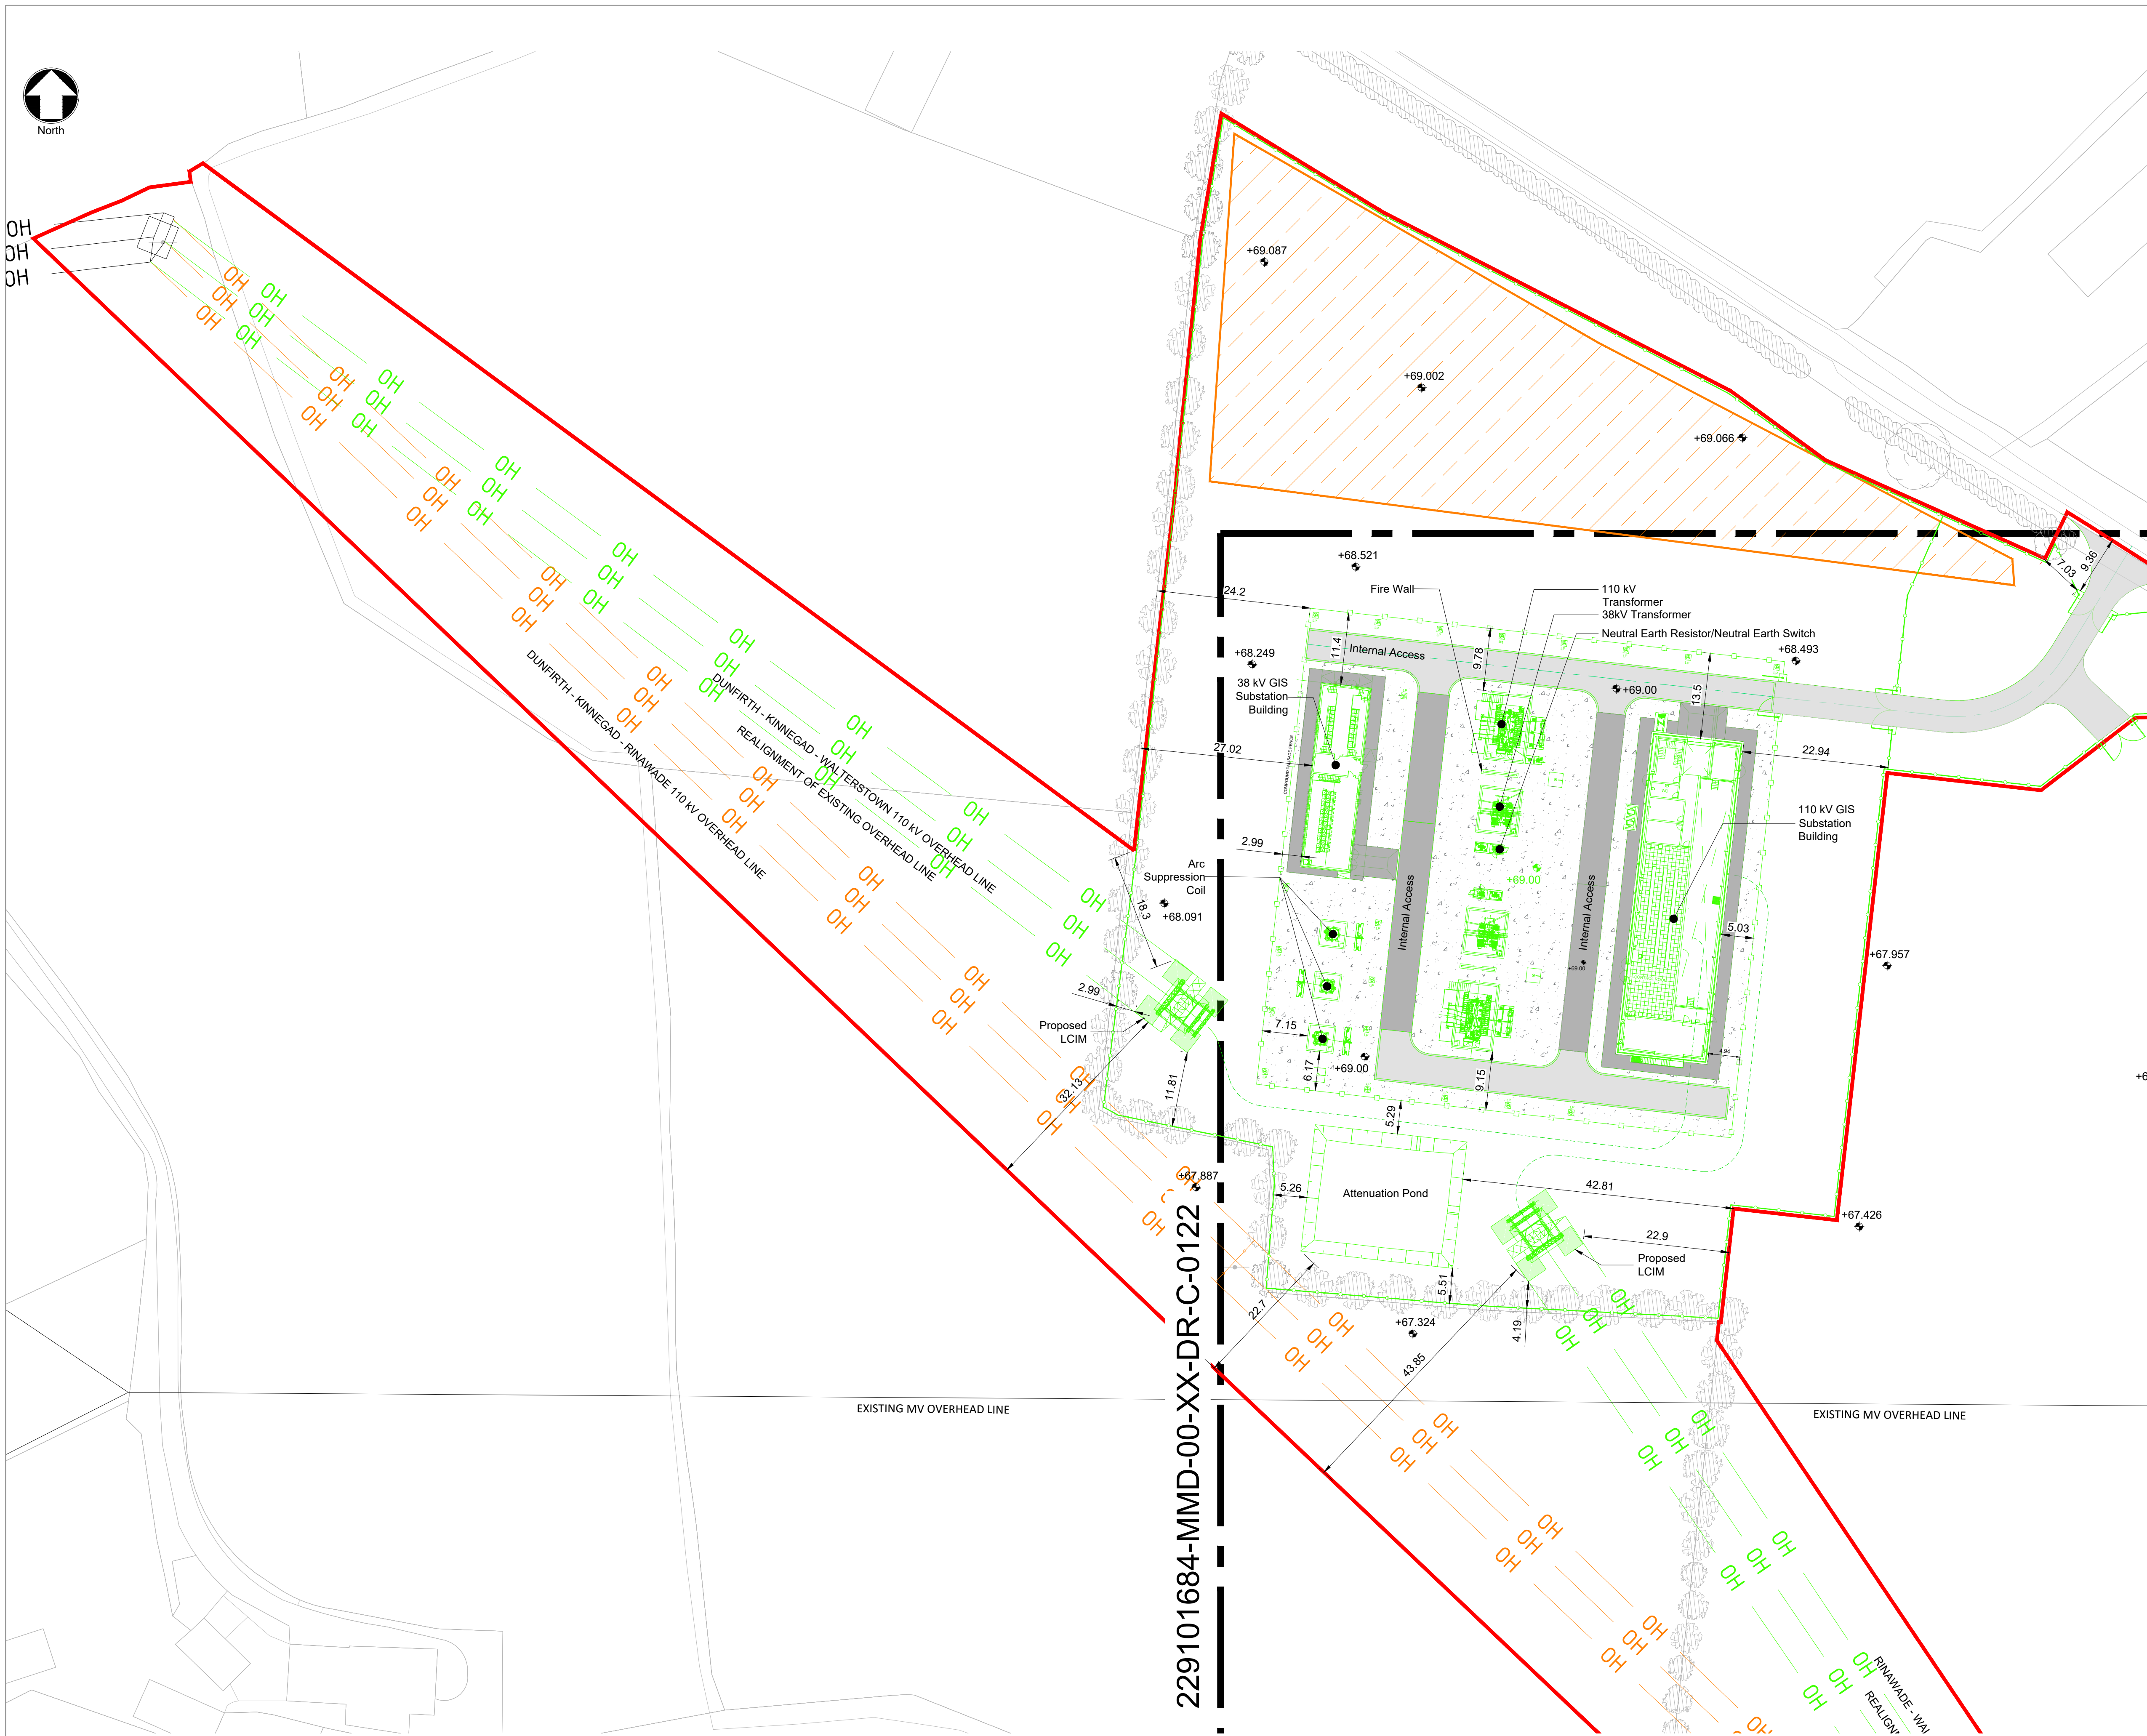

1. For planning purposes only. Not for construction.
2. All dimensions are in metres unless otherwise noted.

	Application Site Boundary
	Proposed Equipment / Infrastructure
	Palisade Fence
	Post & Rail Fence
	110 kV Underground Cables
	Proposed OHL
	Existing OHL
	OHL to be dismantled
	4m High Lighting Pole
	15m High Lightning Mast
	Temporary Construction Compound
	Asphalt Finish
	Concrete Finish
	Hardstanding
	Existing Trees/Hedgerows
	Existing Site Level
	Proposed Site Level



229101684-MMD-00-XX-DR-C-0120 - Site Layout - Key Plan
229101684-MMD-00-XX-DR-C-0122 - Site Layout - Sheet 2
229101684-MMD-00-XX-DR-C-0130 - Contiguous Site Elevations

M

M

**MOTT
MACDONALD**

South Block
Rockfield
Dundrum
Dublin 16
Ireland
T +353 (0)1 291 6700
F
W www.mottmac.com



Title	Walterstown 110kV Substation
	Site Layout
	Sheet 1

Designed	ESB		Eng check	ESB	
Drawn	S. Healy		Coordination	A. Sethi	
Dwg check	G. Reid		Approved	N. Roche	
Scale at A1 1:500	Status PRE		Rev PL1	Security STD	

Drawing Number	229101684-MMD-00-XX-DR-C-0121
----------------	-------------------------------