


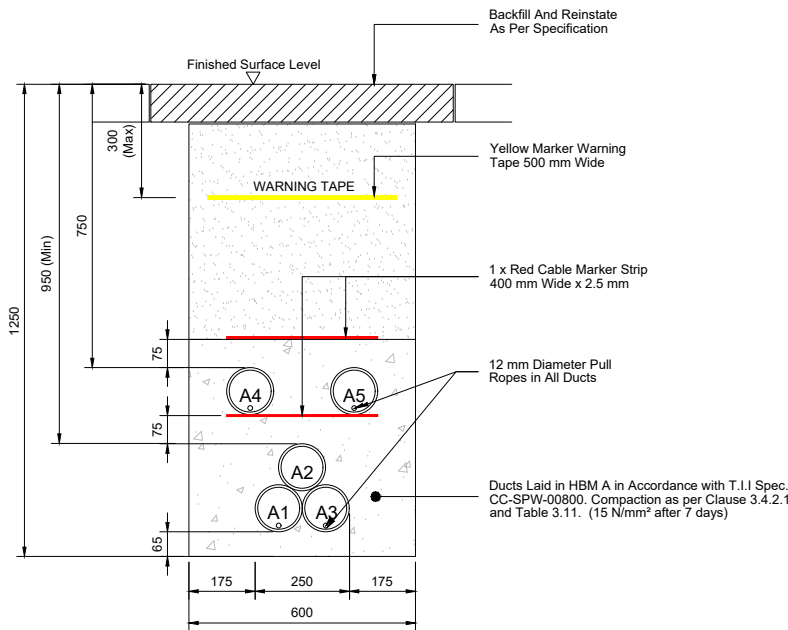

A=125 mm: Outer Diameter HDPE ESB Approved Duct,
SDR=17.6 All Dimensions in Millimetres.

Notes

1. For planning purposes only. Not for construction.
2. All dimensions are in millimetres unless otherwise noted.

Key to symbols

Reference drawings

PL1	12/12/2025	M.O'F.	Issued for Planning	GR	NR
Rev	Date	Drawn	Description	Ch'k'd	App'd

M

MOTT
MACDONALD

South Block
Rockfield
Dundrum
Dublin 16
Ireland
T +353 (0)1 291 6700
F
W www.mottmac.com

Client

Title

Walterstown 110 kV Substation

New Underground Cable Ducts
Details

Designed	ESB	Eng check	ESB	
Drawn	S. Healy	Coordination	A. Sethi	
Dwg check	G. Reid	Approved	N. Roche	
Scale at A1	1:10	Status	PRE	Rev
				PL1
				Security
				STD

Drawing Number

229101684-MMD-00-XX-DR-C-0161